



See our Full Range online at www.vip-ltd.co.uk

Nabic Fig 500 High Lift Safety Valve with Spring

Application

Designed primarily for use on unvented hot water heating systems where a high capacity, emergency steam relief capability is required. High capacity and resilient PTFE seating also make the Fig 500 ideal for steam, air and inert gas applications. A PTFE to Viton seating design is also available where greater seal tightness is required.

Materials of Construction

Gunmetal with diaphragm protected working parts and PTFE to metal seating. All wetted parts are manufactured from dezincification resistant materials, approved by the Water Research Centre for use on potable water. Standard inlet and outlet connections have female threads to BS 21, with the outlet connection one size larger than the inlet. Sizes from DN20 upwards are available with flanged inlet connections; other thread forms are also available.

Features

- Resilient PTFE seating design
- High degree of seat tightness
- Suitable for hot water, steam, air
- Diaphragm protected working parts
- Safe manual testing
- Easy inspection and cleaning
- Pressure setting locked and sealed
- Designed and tested to BS 6759
- Capacities certified by AOTC
- WRAS Approved
- UKWFS listed
- Pad lock available (complies with M&E3)
- Drain plug fitted on sizes DN40 and above allows fitting of a pressure gauge

Pipe Connections

Screwed female inlet and outlet connections. Outlet connection is one size larger than inlet connection. Threaded connections are 'Rp' parallel to BS EN 10226-1. NPT connections are available upon request.



VIP Product Code
46/0500



This product can be set at our works,
certified and dispatched for next day
delivery.

Working Conditions

Max Set Pressure: 12.5 Bar

Min Set Pressure: 0.4 Bar

Max Temperature: 195°C

Min Temperature: -20°C

Medium: Hot water, steam, compressed
air and inert gasses, CO² (to 20°C),
ethylene glycol, potable water

Connection: Screwed inlet & outlet

LONDON


Incorporating HEVAC Industrial
Unit 8, Hounslow Trade Park
Hounslow, TW3 3FW
T: 020 8577 7667
E: londonsales@vip-ltd.co.uk



VALUE IS PARAMOUNT

MANCHESTER

Incorporating F Ashton Ltd
VIP House, Chaddock Lane
Astley, M29 7JT
T: 01942 885 700
E: sales@vip-ltd.co.uk

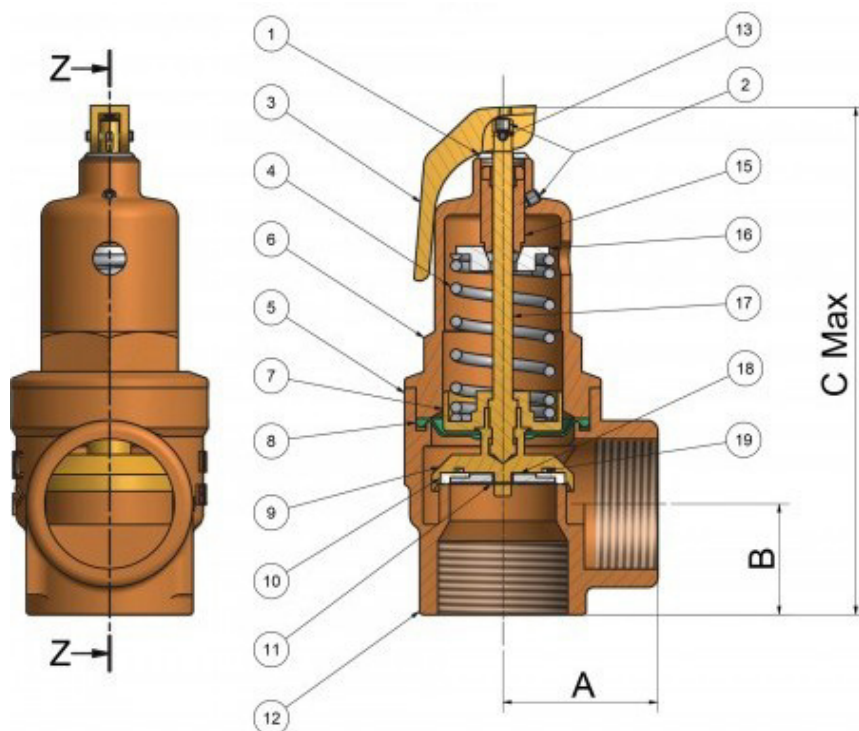

Dimensions							
VIP Stock Reference	DN	Rp BSP Inlet	Rp BSP Outlet	A	B	C	Weight (kg)
46/0500/015	15	1/2"	3/4"	33	20	120	0.53
46/0500/020	20	3/4"	1"	39	24	132	0.76
46/0500/025	25	1"	1 1/4"	45	30	155	1.35
46/0500/032	32	1 1/4"	1 1/2"	54	36	201	2.35
46/0500/040	40	1 1/2"	2"	64	41	241	4.20
46/0500/050	50	2"	2 1/2"	76	47	267	6.80
46/0500/065	65	2 1/2"	3"	90	60	330	12.50

Materials of Construction		
Item	Part name	Material
1	Thrust washer	Brass, BS EN 12164 CW609N
2	Grubscrew	Steel
3	Test lever	Brass, BS EN 1982 CC754S
4	Spring	Chrome vanadium alloy steel, BS 2803 735 A50 HS (Stainless steel, BS 2056 302S26 optional)
5	Label	Yellow kapton
6	Spring cover	Bronze, BS EN 1982 CC491K
7	Piston	Brass, BS EN 12164 CW609N
8	Diaphragm	Silicon Rubber
9	Seat seal holder	Bronze, BS EN 1982 CC491K/Brass BS EN 12164 CW602N (DZR)
10	Seat seal	PTFE (Viton optional)
11	Starlock washer	Stainless steel
12	Body	Bronze, BS EN 1982 CC491K
13	Lever pin	Steel
14	Lead seal (not shown)	Lead
15	Adjusting screw	Brass, BS EN 12164 CW609N
16	Spring Plate	Brass, BS EN 12164 CW609N
17	Spindle	Brass, BS EN 12164 CW721R
18	Seat seal retaining plate	Bronze, BS EN 1982 CC491K/Brass BS EN 12164 CW602N (DZR)
19	O-ring	Viton

LONDON

Incorporating HEVAC Industrial
Unit 8, Hounslow Trade Park
Hounslow, TW3 3FW
T: 020 8577 7667
E: londonsales@vip-ltd.co.uk



VALUE IS PARAMOUNT

MANCHESTER

Incorporating F Ashton Ltd
VIP House, Chaddock Lane
Astley, M29 7JT
T: 01942 885 700
E: sales@vip-ltd.co.uk



Discharge Capabilities

The discharge capacity of a safety valve must be equal to or greater than the output of the boiler or system it is protecting. To ensure that the correct method of sizing is used, reference should be made to the relevant BS specification for the design of the boiler or system. Fig 500 capacities are tabulated below to assist selection.

Air capacity - 10% Overpressure (BS N 4126-1) Std. Litres/sec (Kdr=0.479)								
Set Pressure (Bar)	DN10	DN15	DN20	DN25	DN32	DN40	DN50	DN80
1.0	18	34	61	95	156	244	381	644
2.0	28	52	93	145	238	372	581	982
3.0	38	70	125	195	320	500	780	1319
4.0	47	88	157	245	401	628	980	1656
6.0	67	124	221	345	565	883	1379	2331
8.0	86	160	284	445	728	1139	1778	3006
10.0	105	196	348	545	892	1394	2178	3681
12.5	130	241	428	670	1096	1714	2677	4524

Std. Litres/sec (Kdr=0.479)

To convert to ft³/min multiply by 2.1

Steam - 10% Overpressure (BS 6759) Kg/hr (Kdr=0.479)								
Set Pressure (Bar)	DN10*	DN15*	DN20	DN25	DN32	DN40	DN50	DN65
1.0	50	93	166	259	425	664	1037	1752
2.0	76	142	253	395	647	1012	1580	2670
3.0	103	191	340	531	869	1359	2123	3588
4.0	129	240	427	667	1092	1707	2666	4506
6.0	182	338	600	938	1537	2402	3752	6341
8.0	234	436	774	1210	1981	3098	4838	8177
10.0	287	534	948	1482	2426	3793	5924	10013
12.5	352	657	1165	1821	2982	4663	7281	12307

Kg/hr (Kdr=0.479) To convert to lb/hr multiply by 2.2

* The minimum bore size permitted by BS specifications for steam and hot water boilers is 20mm.
Capacities given for the smaller sizes in the tables are for applications outside the scope of these standards.

LONDON

Incorporating HEVAC Industrial
Unit 8, Hounslow Trade Park
Hounslow, TW3 3FW
T: 020 8577 7667
E: londonsales@vip-ltd.co.uk



VALUE IS PARAMOUNT

MANCHESTER

Incorporating F Ashton Ltd
VIP House, Chaddock Lane
Astley, M29 7JT
T: 01942 885 700
E: sales@vip-ltd.co.uk



VALVES INSTRUMENTS PLUS

WWW.VIP-LTD.CO.UK

Hot Water - Unvented System - 10% Overpressure (BS EN 4126-1) Kg/hr (Kdr=0.19)

Set Pressure (Bar)	DN10*	DN15*	DN20	DN25	DN32	DN40	DN50	DN65
1.0	31	59	104	162	266	416	650	1098
2.0	48	89	158	248	405	634	990	1673
3.0	64	120	213	333	545	852	1330	2248
4.0	81	151	267	418	684	1070	1670	2824
6.0	114	212	376	588	963	1505	2351	3974
8.0	147	273	485	758	1242	1941	3032	5124
10.0	180	335	594	929	1520	2377	3712	6275
12.5	221	411	730	1141	1869	2922	4563	7713

Kg/hr (Kdr=0.479) To convert to Btu/hr multiply by 3,400

The capacities tabulated are for unvented (pressurised or sealed) heating systems. For vented systems we generally recommend the use of Fig 542 Safety Relief Valves. Fig 500 Safety Valves can be used for high output systems where its greater discharge capacity is advantageous. For unvented hot water supply systems, Fig 500T Combined Pressure & Temperature Relief Valves should be used.

Hot Water - Unvented System - 10% Overpressure (BS EN 4126-1) kW (Kdr=0.19)

Set Pressure (Bar)	DN10	DN15	DN20	DN25	DN32	DN40	DN50	DN65
1.0	40	75	134	209	343	536	837	1414
2.0	57	107	189	296	485	758	1183	2000
3.0	70	131	232	363	594	928	1449	2450
4.0	81	151	268	419	685	1072	1674	2829
6.0	99	185	328	513	840	1313	2050	3465
8.0	115	213	379	592	969	1516	2367	4001
10.0	128	239	423	662	1084	1695	2646	4473
12.5	143	267	473	740	1212	1895	2959	5001

Kg/min water (Kdr=0.479)

In the above tables, discharge capacities have been calculated in accordance with BS EN 4126-1 & BS 6759, using a derated coefficient of discharge (Kdr) 0.479, approved by AOTC.

LONDON

Incorporating HEVAC Industrial
Unit 8, Hounslow Trade Park
Hounslow, TW3 3FW
T: 020 8577 7667
E: londonsales@vip-ltd.co.uk



VALUE IS PARAMOUNT

MANCHESTER

Incorporating F Ashton Ltd
VIP House, Chaddock Lane
Astley, M29 7JT
T: 01942 885 700
E: sales@vip-ltd.co.uk